



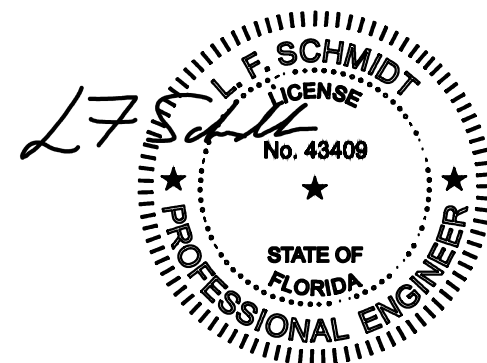

**OPAQUE FIBERGLASS DOOR
DOUBLE
w/ or w/out SIDELITE(S)
INSWING/OUTSWING
"IMPACT"**

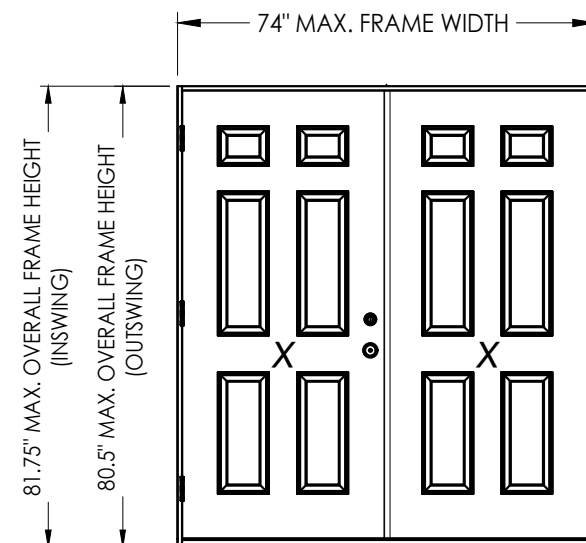

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Technical drawing of a double door with dimensions and frame details. The drawing shows a top-down view of the door assembly, including the door panels, frame, and hardware (handles, lock, and hinges).

Dimensions and Frame Details:

- 105" MAX. O.A. FRAME WIDTH
- 74" MAX. FRAME WIDTH
- 15.5" MAX. FRAME WIDTH
- 81.75" MAX. OVERALL FRAME HEIGHT (INSWING)
- 80.5" MAX. OVERALL FRAME HEIGHT (OUTSWING)

The door panels feature a decorative design with rectangular and square elements. The left panel has a circular handle, and the right panel has a circular handle and a lock. The door is shown in a closed position, with the frame and hinges visible.

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and excludes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS			
SHEET #	DESCRIPTION	SHEET #	
1	Typical Elevations, Design Pressures & General Notes	7	Horizontal & Vertical Cross Sections (1X Buck)
2	Door Panel Details	8	Horizontal & Vertical Cross Sections (Direct to Masonry)
3	Sidelite Panel Details	9	Vertical Cross Sections (Thresholds)
4	Elevations	10	Buck Anchoring
5	Horizontal Cross Sections	11	Frame Anchoring & Hardware Details
6	Horizontal & Vertical Cross Sections (2X Buck)	12	Bill of Materials & Components

CONFIGURATION	MAX. FRAME DIMENSION	DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE
XX	74" x 81.75"	+50.0	-50.0
OX XO	105" x 81.75"	+50.0	-50.0


[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


© 2023 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Trinity Glass Int\VL-37185 R2\VL-37185.4.dwg

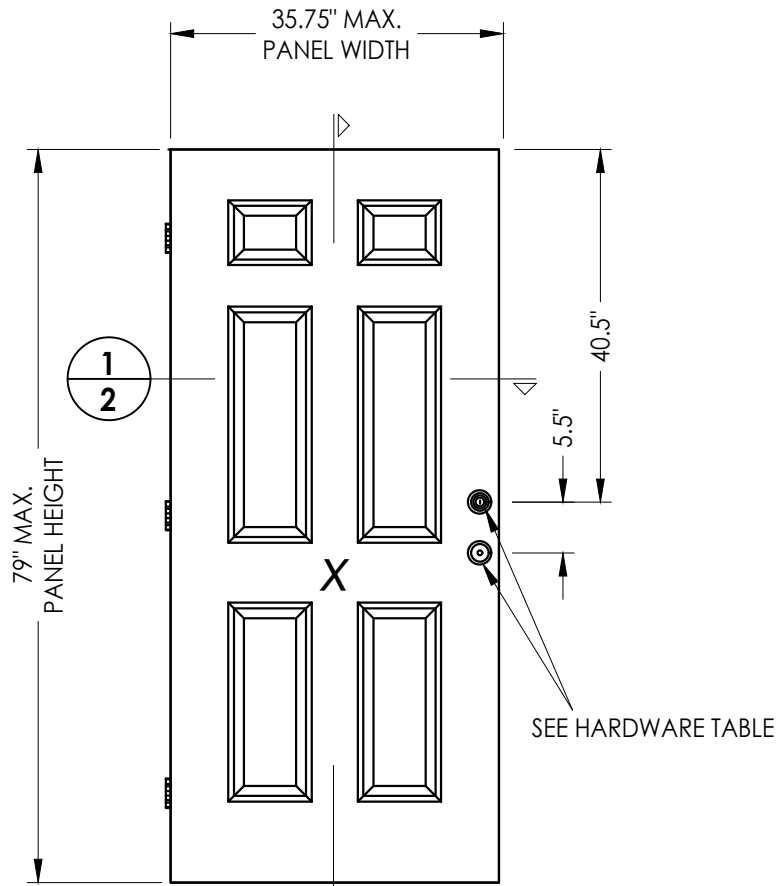


40 FIBERGLASS DOOR PANEL

FIBERGLASS SKIN: 0.079" MIN. THK.
FOAM CORE: POLYURETHANE - 1.9 PCF MIN.)

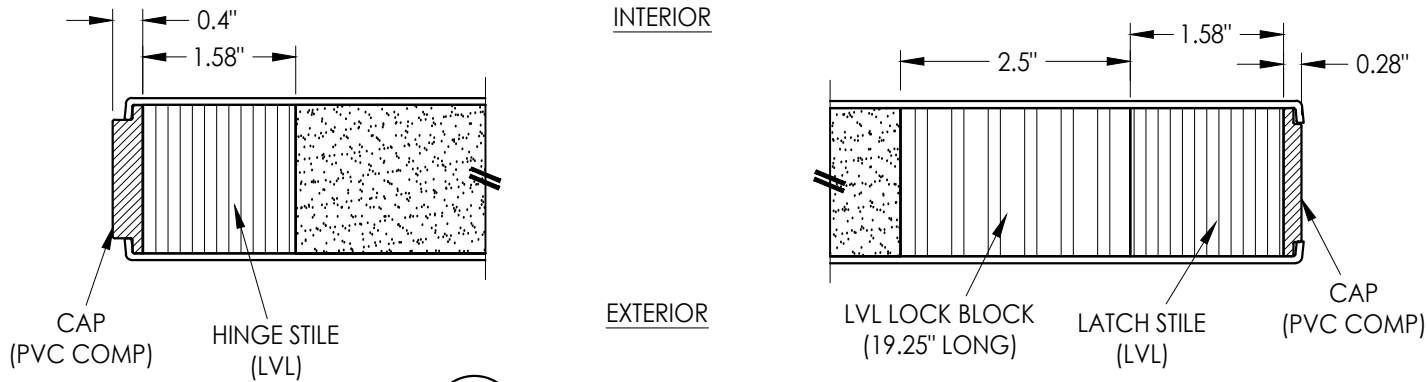

1
2 HORIZONTAL CROSS SECTION

HARDWARE TABLE		
MANUFACTURER	MODEL	
KWIKSET	KNOB:	SIGNATURE SERIES
	DEADBOLT:	SIGNATURE SERIES (980)
SCHLAGE	KNOB:	F51
	DEADBOLT:	B60N

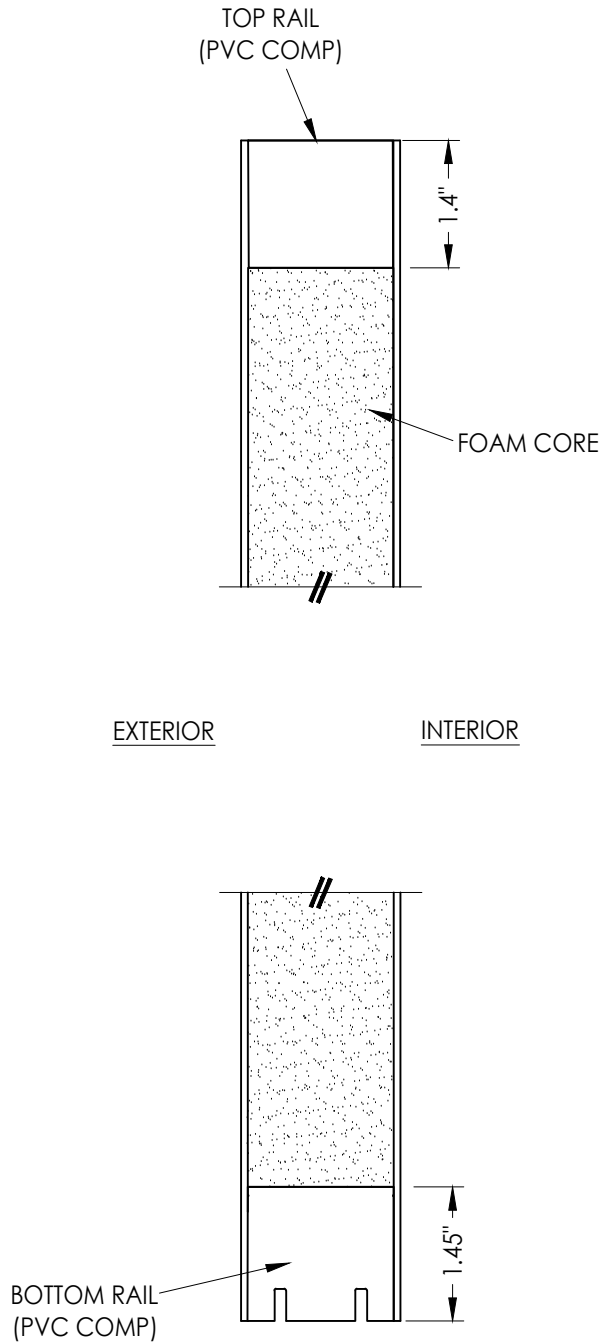


2
2 VERTICAL CROSS SECTION

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:	TRINITY FIBERGLASS PATIO DOOR "Impact"							
PART OR ASSEMBLY:	DOOR PANEL DETAILS							
NO.	1	DATE	7/31/23	UPDATE TO	8TH ED. (2023)	FBC	LFS	BY
REVISIONS								
DATE: 6/22/23								
SCALE: N.T.S.								
DWG. BY: RW								
CHK. BY: LFS								
DRAWING NO.: FL-37185.4								
SHEET 2 OF 12								


Z:\2023 FBC Drawings\Trinity Glass Int\VL-37185 R2\VL-37185.4.dwg

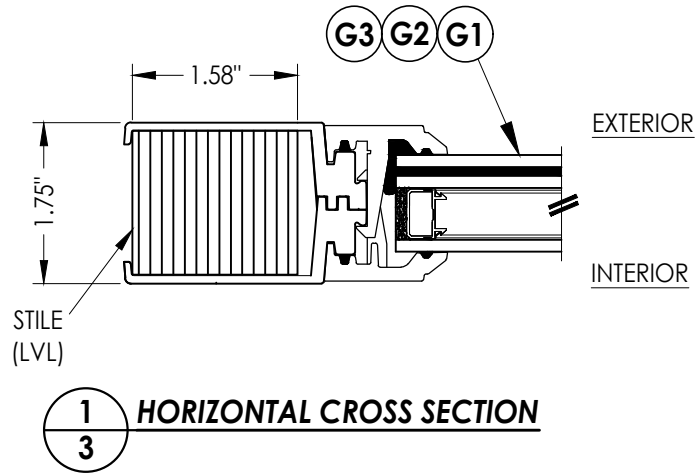


1
3 HORIZONTAL CROSS SECTION

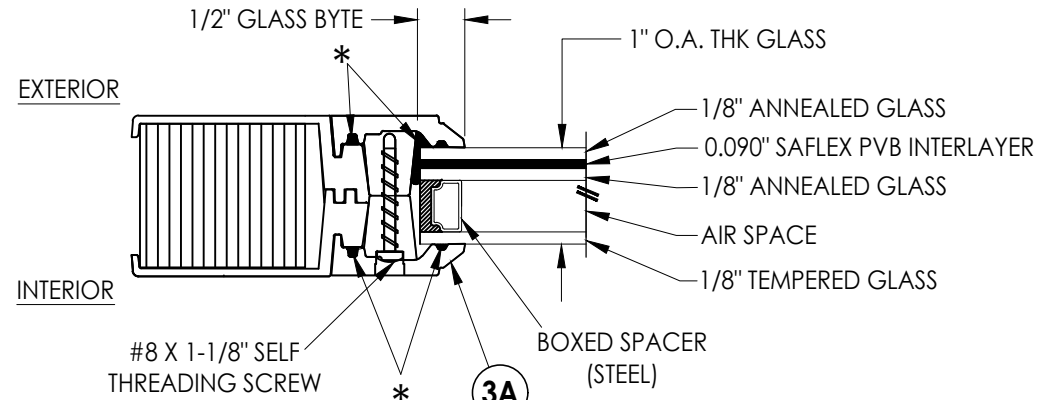


G1 GLAZING DETAIL

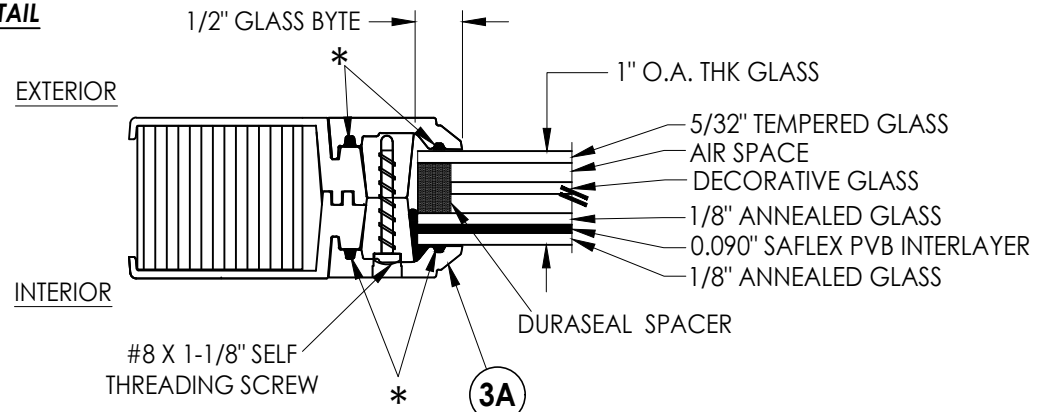

G2 GLAZING DETAIL
DECORATIVE GLASS

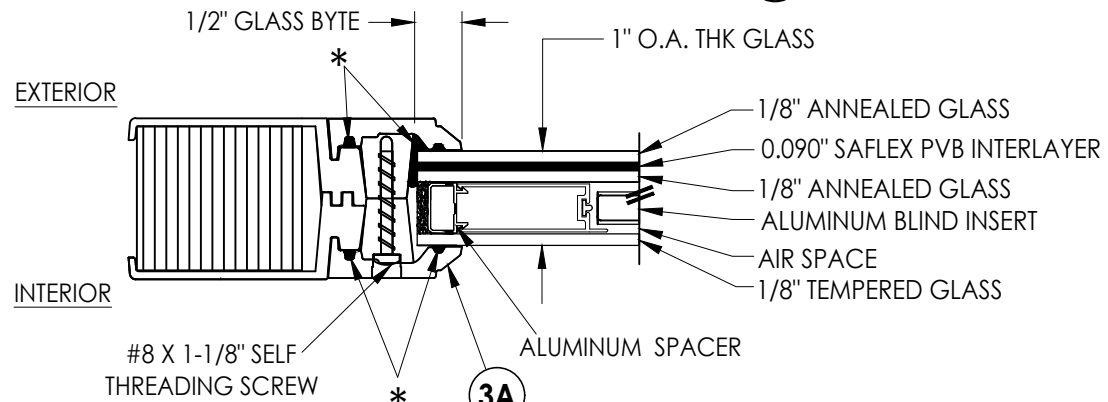


G3 GLAZING DETAIL
BLINDS BETWEEN GLASS

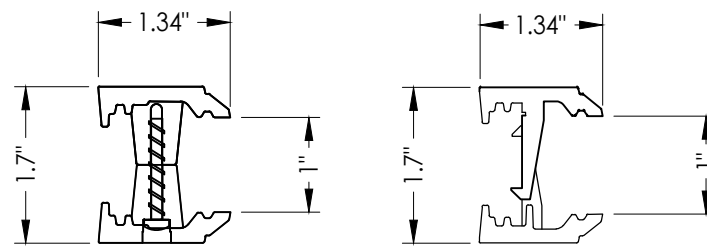


SECTION @ SCREW

SECTION @ HOOK TAB

3A FLUSH GLAZING FRAME
ABS

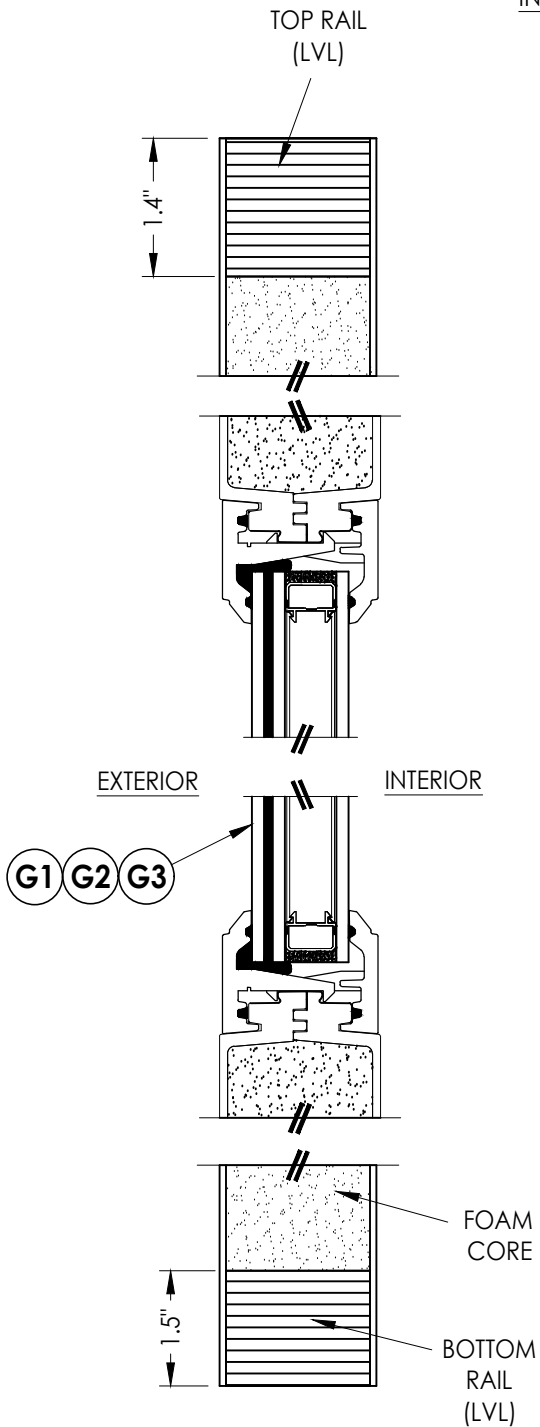

2
3 VERTICAL CROSS SECTION

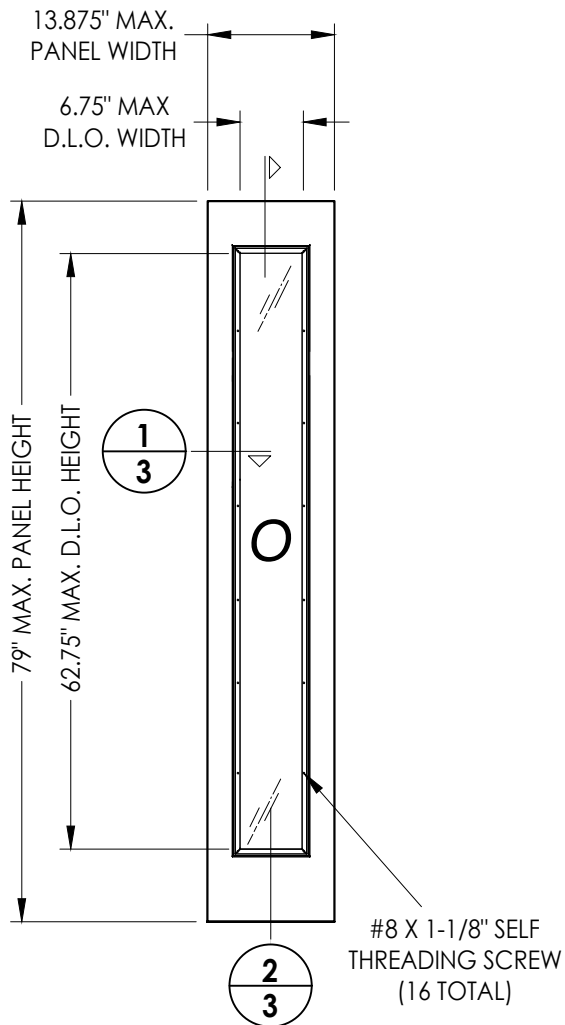

50 FIBERGLASS SIDELITE PANEL

FIBERGLASS SKIN: 0.079" MIN. THK. (Fy = 10,000 PSI MIN.)
FOAM CORE: POLYURETHANE - 1.9 PCF MIN.)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: TRINITY
FIBERGLASS PATIO DOOR
"Impact"

PART OR ASSEMBLY:
SIDELITE
PANEL DETAILS

NO.	DATE	REVISIONS
1	7/31/23	UPDATE TO 8TH ED. (2023) FBC
		LFS
		BY

DATE: 6/22/23

SCALE: N.T.S.



DWG. BY: RW

CHK. BY: LFS

DRAWING NO.:

FL-37185.4

SHEET 3 OF 12

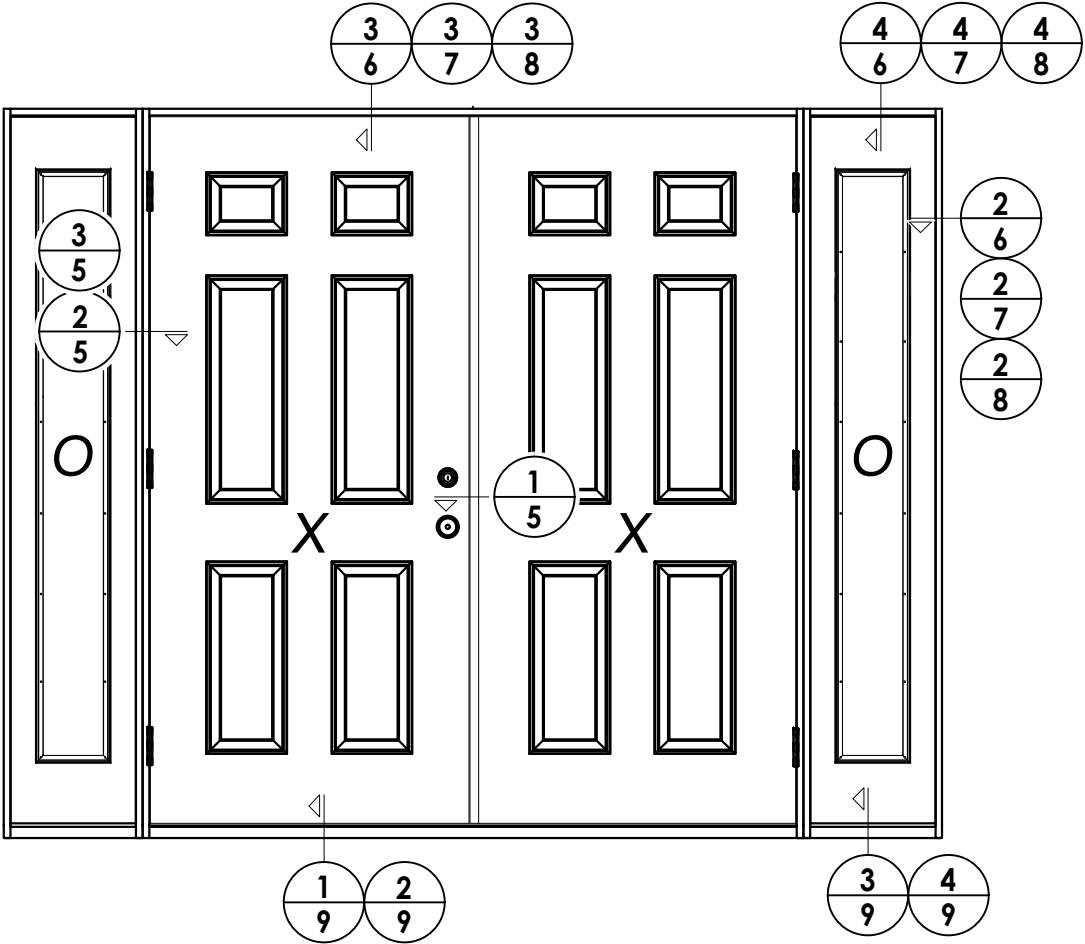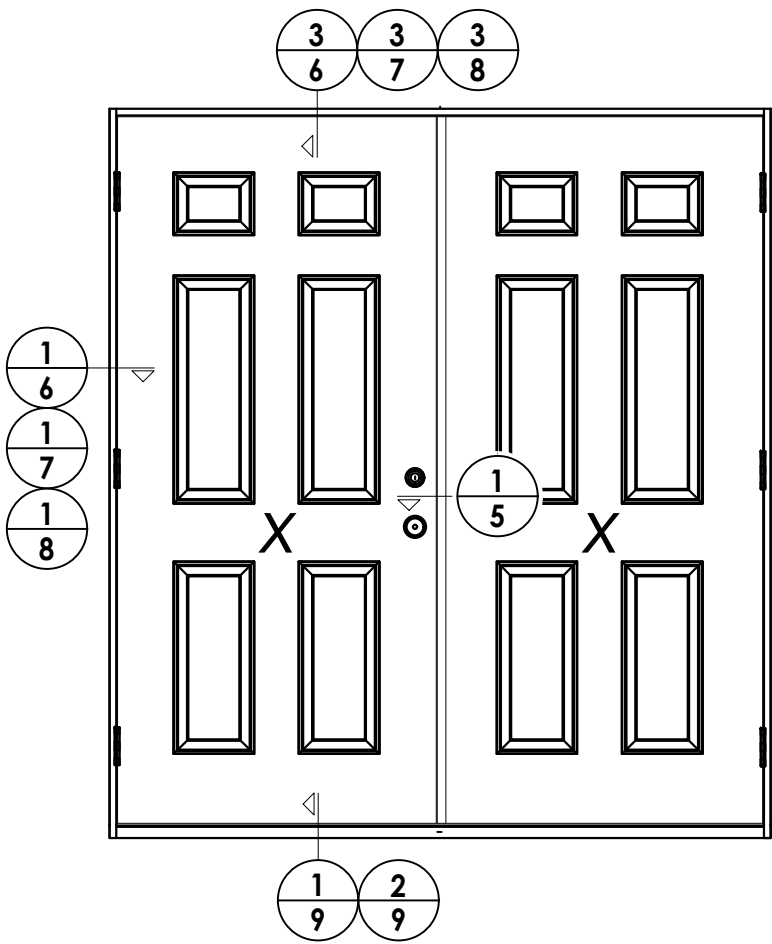

DATE: 6/22/23
SCALE: N.T.S.
DWG. BY: RW
CHK. BY: LFS
DRAWING NO.: FL-37185.4
SHEET 4 OF 12


NO.	DATE	DESCRIPTION	BY
1	7/31/23	UPDATE TO 8TH ED. (2023) FBC	LFS

PRODUCT:	TRINITY FIBERGLASS PATIO DOOR "Impact"
PART OR ASSEMBLY:	ELEVATIONS


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Trinity Glass Int\FL-37185 R2\F1-37185.4.dwg

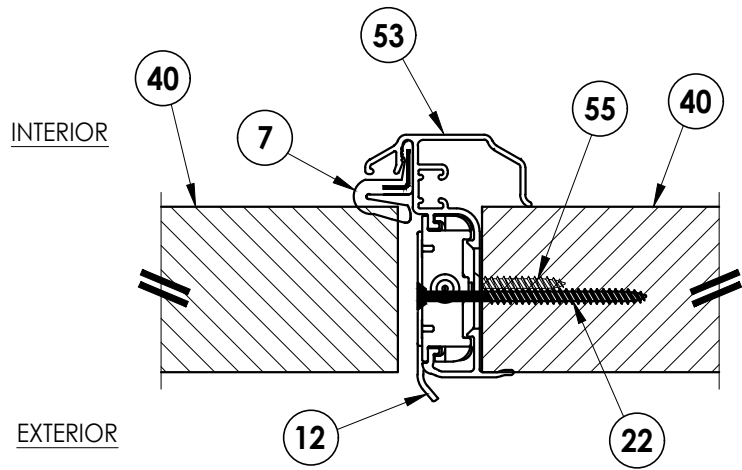

1
5 **HORIZONTAL CROSS SECTION**
Outswing Shown (Inswing Similar)

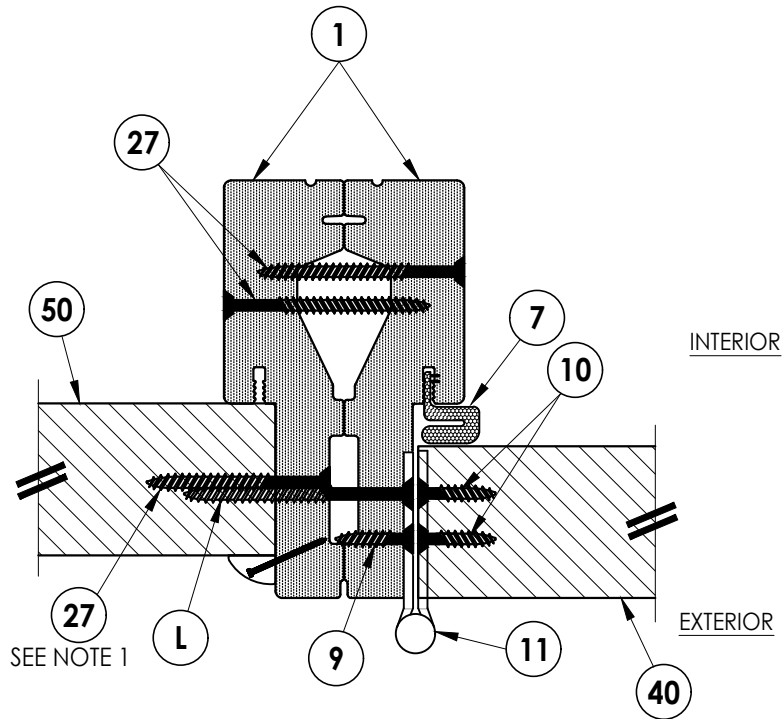

2
5 **HORIZONTAL CROSS SECTION**
Outswing Shown (Inswing Similar)
Shown w/ PVC Jambs

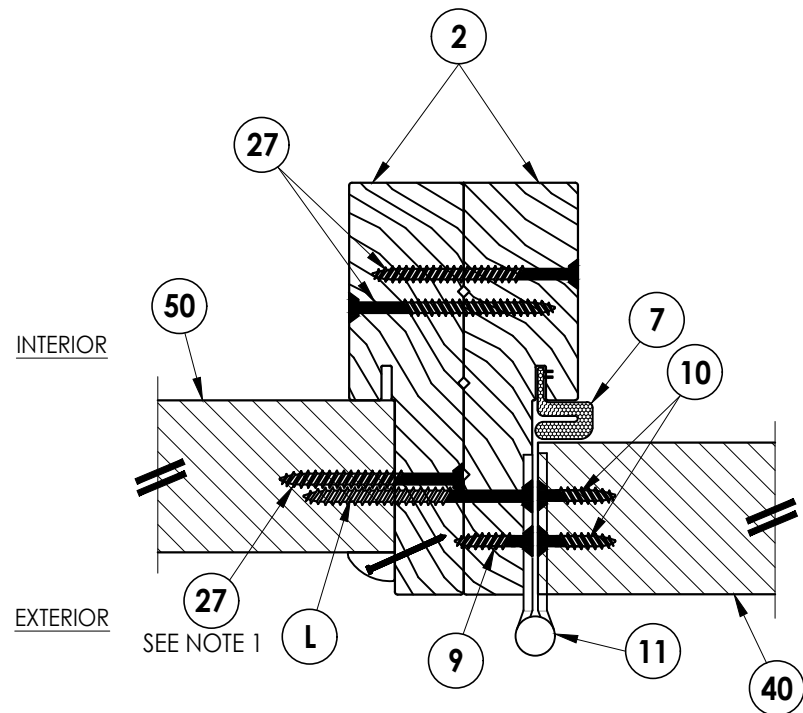

3
5 **HORIZONTAL CROSS SECTION**
Outswing Shown (Inswing Similar)
Shown w/ Wood Jambs

Notes:



1. Sidelite assembly screws located 6" from each end and 4 more screws equally spaced between (6 screws total per side jamb).
2. Moulding secured w/ 16 GA X 1" brad nails located 1" from ends & 6" o.c. max.

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: TRINITY FIBERGLASS PATIO DOOR "Impact"		PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS	
</			

Z:\2023 FBC Drawings\Trinity Glass Int\FL-37185 R2\FL-37185.4.dwg


Notes:

1. Sidelite assembly screws located 6" from each end and 4 more screws equally spaced between (6 screws total per side jamb).
2. Sidelite assembly screws located @ centerline (1 screw total along head).
3. Moulding secured w/ 16 GA X 1" brad nails located 1" from ends & 6" o.c. max.

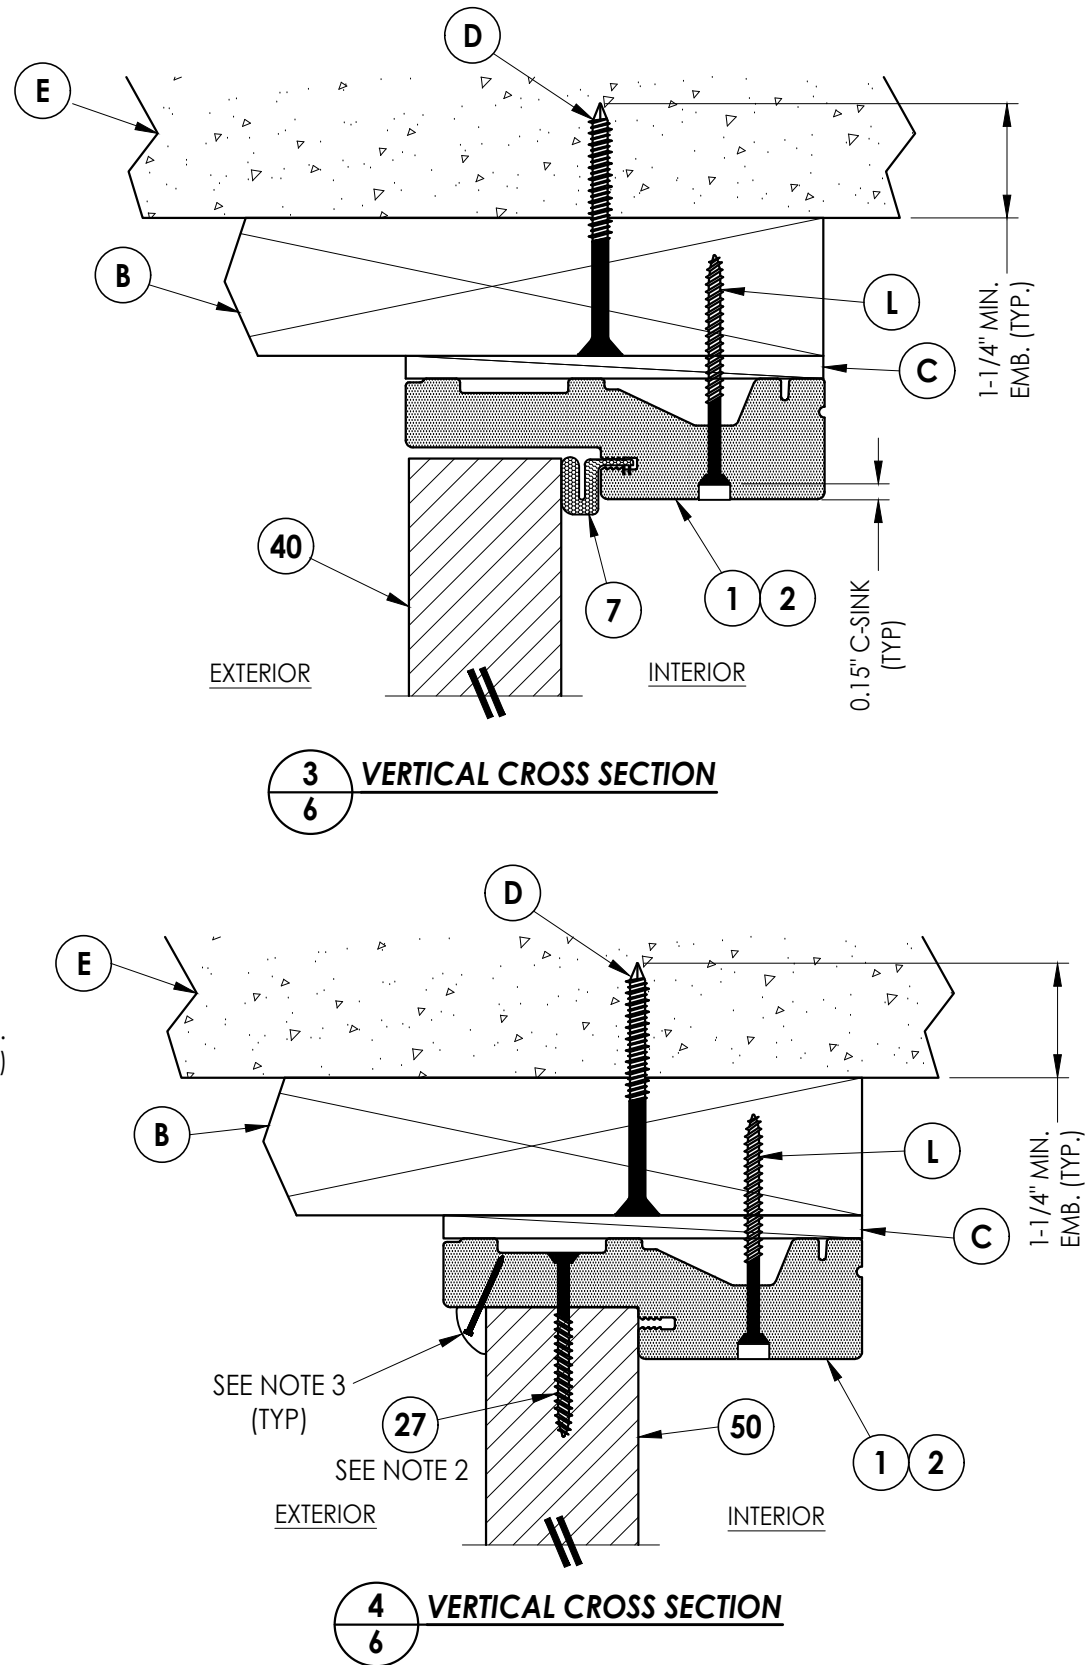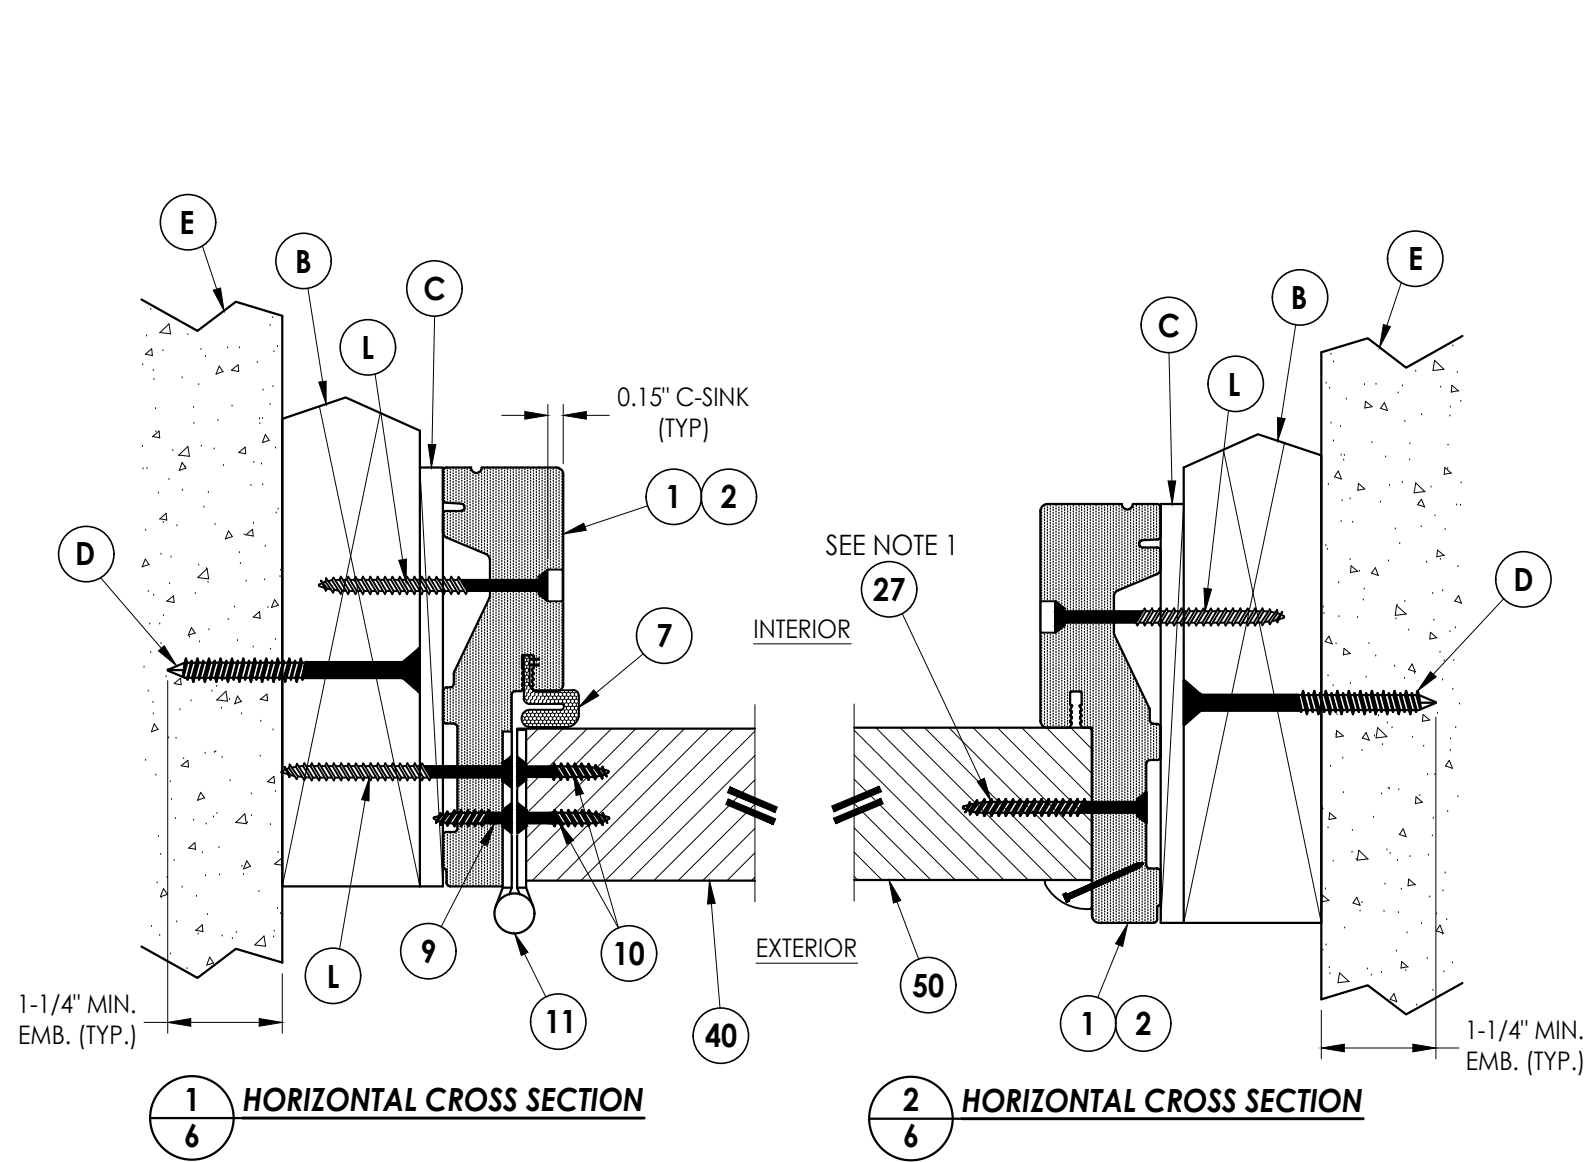


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		RW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT:	TRINITY FIBERGLASS PATIO DOOR "Impact"	PART OR ASSEMBLY:	HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)
DATE:	6/22/23	NO.	1
SCALE:	N.T.S.	DATE	7/31/23
DWG. BY:	RW	BY	LFS
CHK. BY:	LFS	REVISIONS	
DRAWING NO.:	FL-37185.4		
SHEET	6	OF	12


Z:\2023 FBC Drawings\Trinity Glass Int\FL-37185 R2\F-37185.4.dwg

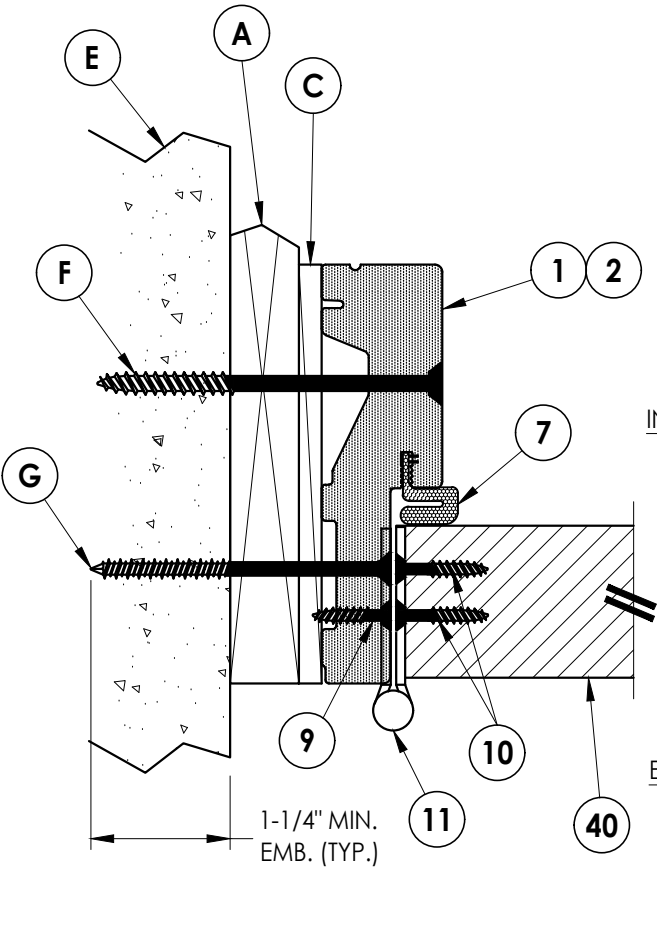


1
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck

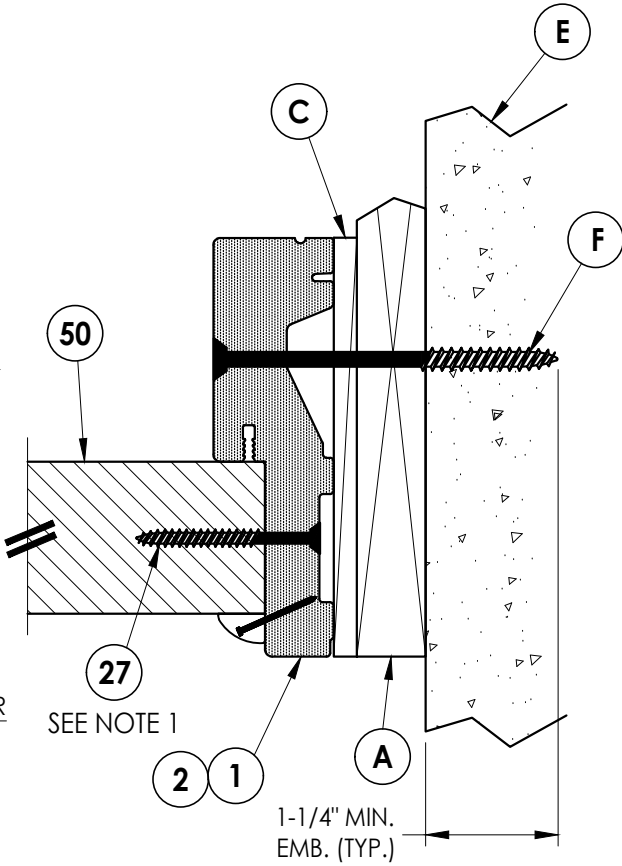

2
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck

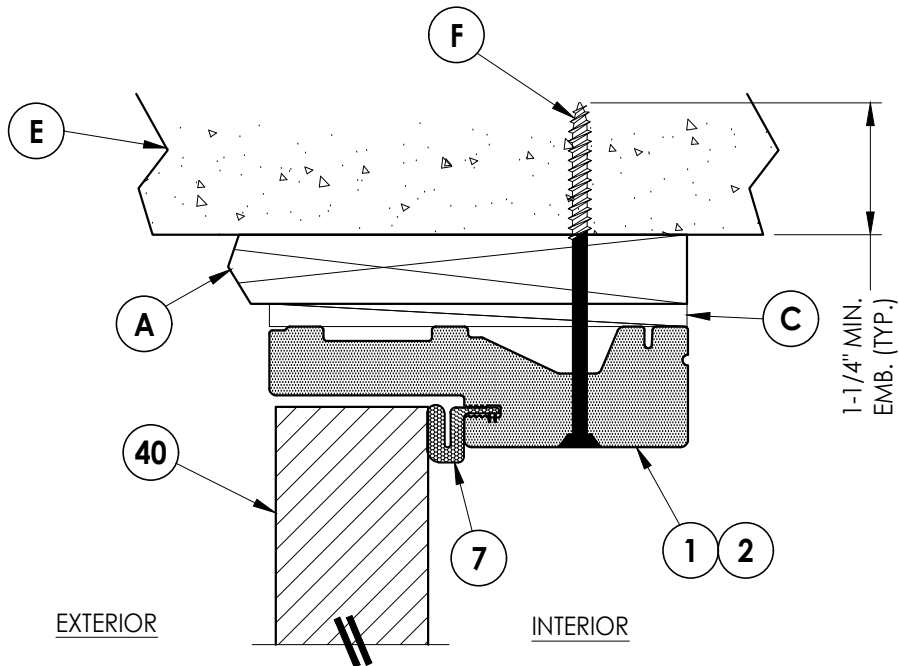

3
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck

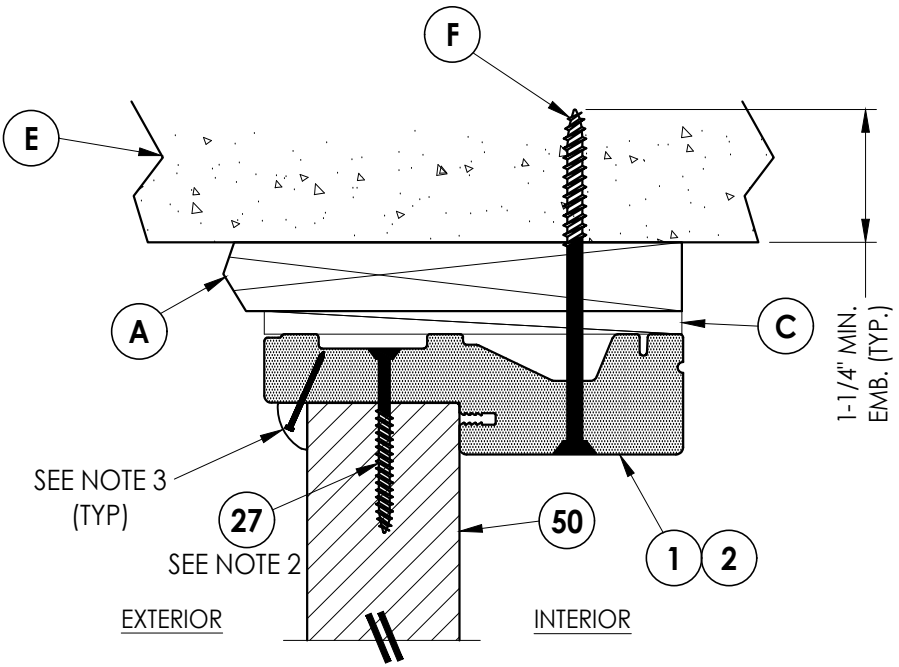

4
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck

Notes:

1. Sidelite assembly screws located 6" from each end and 4 more screws equally spaced between (6 screws total per side jamb).
2. Sidelite assembly screws located @ centerline (1 screw total along head).
3. Moulding secured w/ 16 GA X 1" brad nails located 1" from ends & 6" o.c. max.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: TRINITY
FIBERGLASS PATIO DOOR
"Impact"

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

NO.	DATE	REVISIONS	BY
1	7/31/23	UPDATE TO 8TH ED. (2023) FBC	LFS

DATE: 6/22/23

SCALE: N.T.S.

DWG. BY: RW


CHK. BY: LFS

DRAWING NO.:

FL-37185.4



SHEET 7 OF 12

Z:\2023 FBC Drawings\Trinity Glass Int\VL-37185 R2\VL-37185.4.dwg

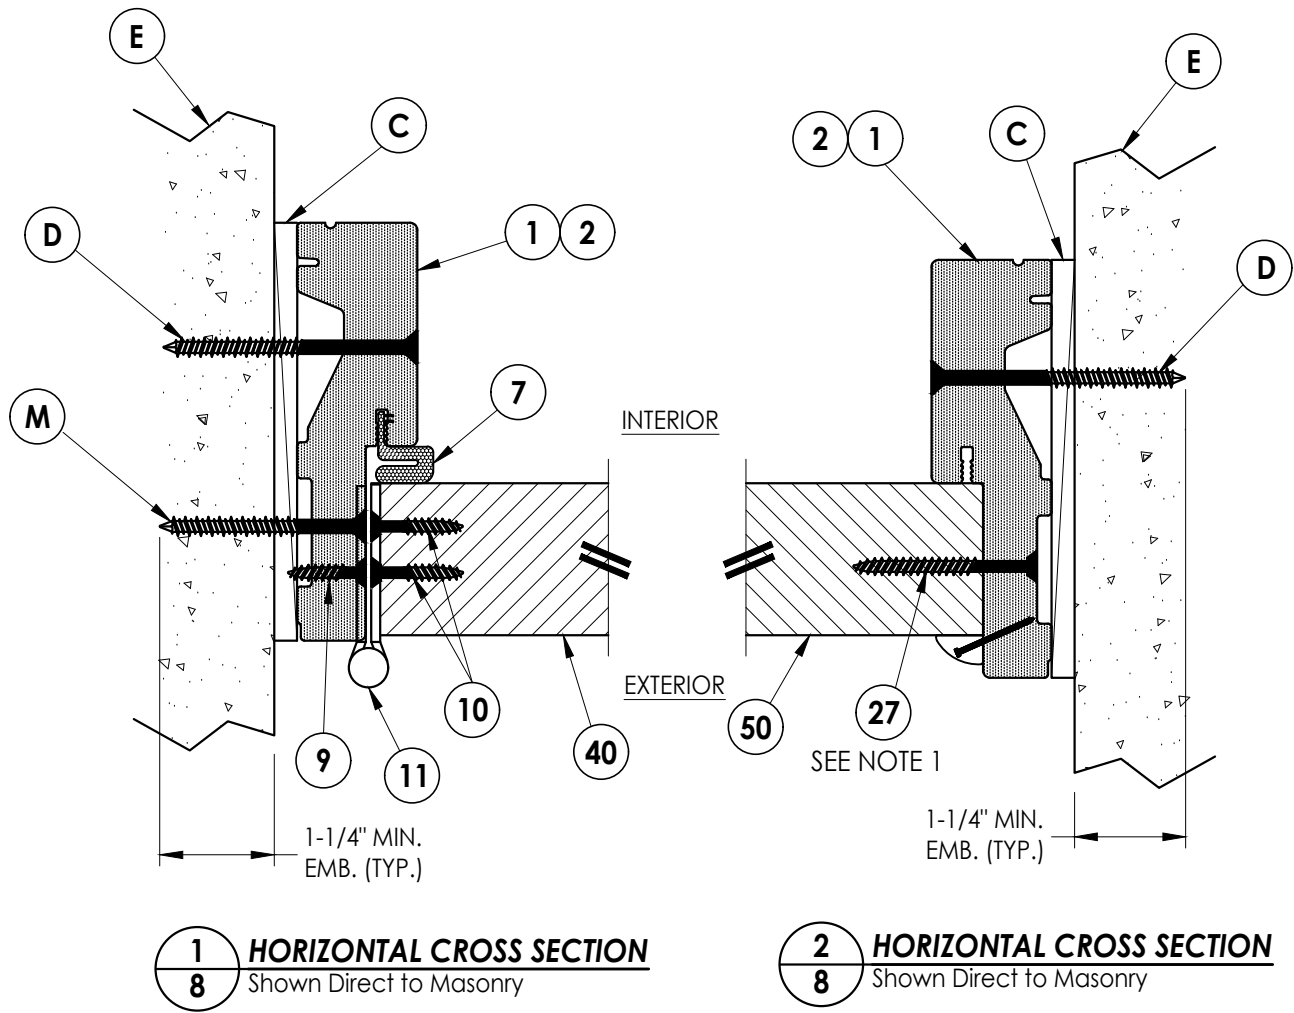



Notes:

1. Sidelite assembly screws located 6" from each end and 4 more screws equally spaced between (6 screws total per side jamb).
2. Sidelite assembly screws located @ centerline (1 screw total along head).
3. Moulding secured w/ 16 GA X 1" brad nails located 1" from ends & 6" o.c. max.

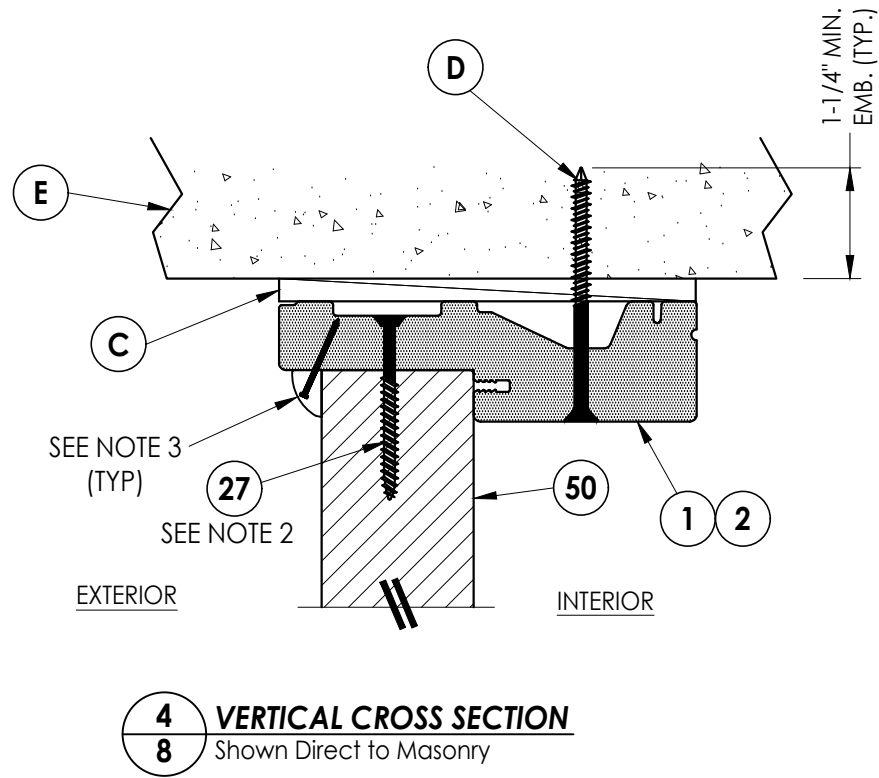
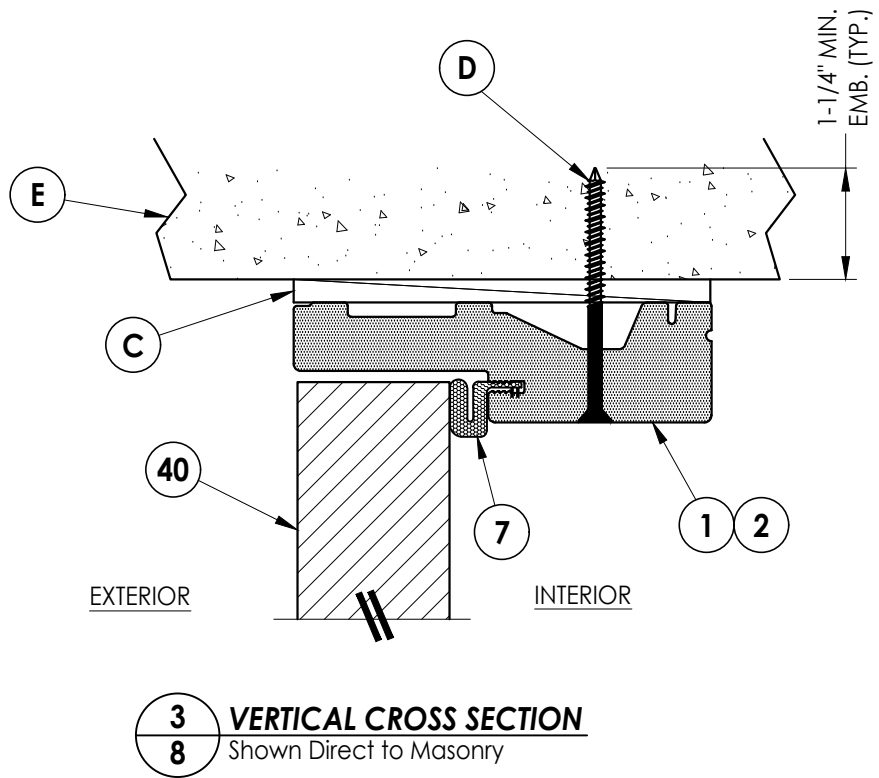


Documents Prepared By:		Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT:		TRINITY FIBERGLASS PATIO DOOR "Impact"		PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS (DIRECT TO MASONRY)	
				REVISIONS	
				DATE: 6/22/23	
				SCALE: N.T.S.	
				DWG. BY: RW	
				CHK. BY: LFS	
				DRAWING NO.: FL-37185.4	
				SHEET 8 OF 12	
				DATE: 7/31/23	
				NO. DATE	
				1 7/31/23 UPDATE TO 8TH ED. (2023) FBC	
				LFS BY	

1. Sidelite assembly screws located @ centerline (1 screw total along sill).

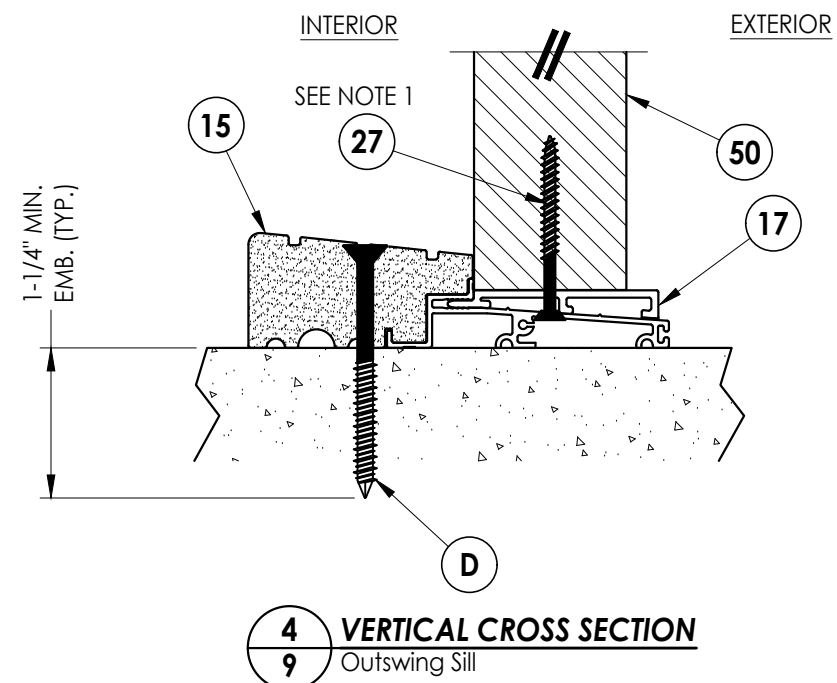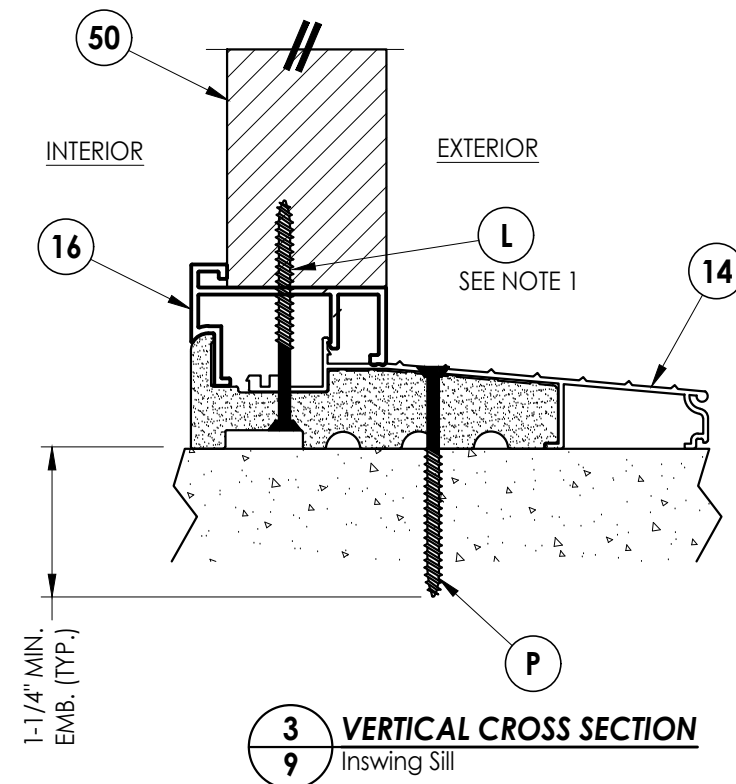[illegible]





Z:\2023 FBC Drawings\Trinity Glass Int'\FL-37185 R2\FL-37185.4.dwg

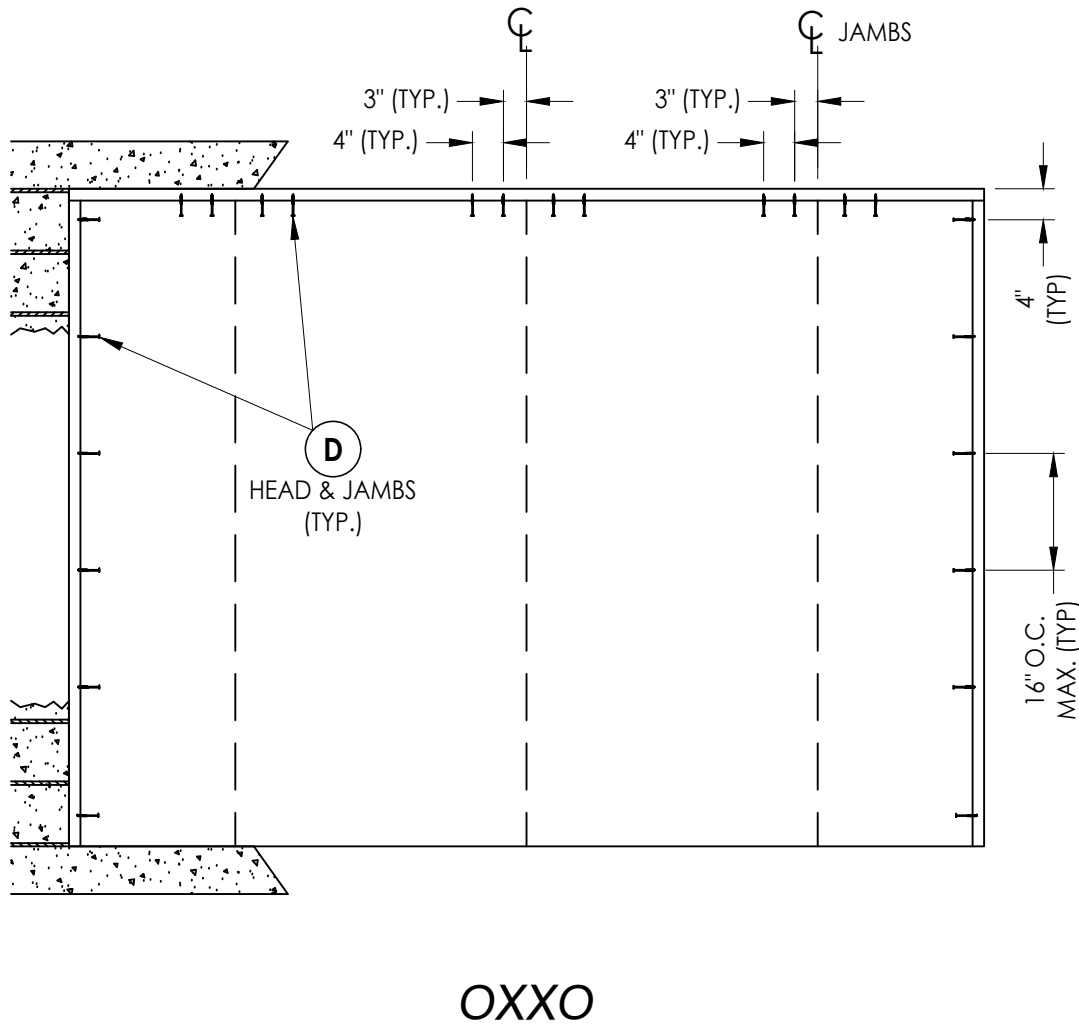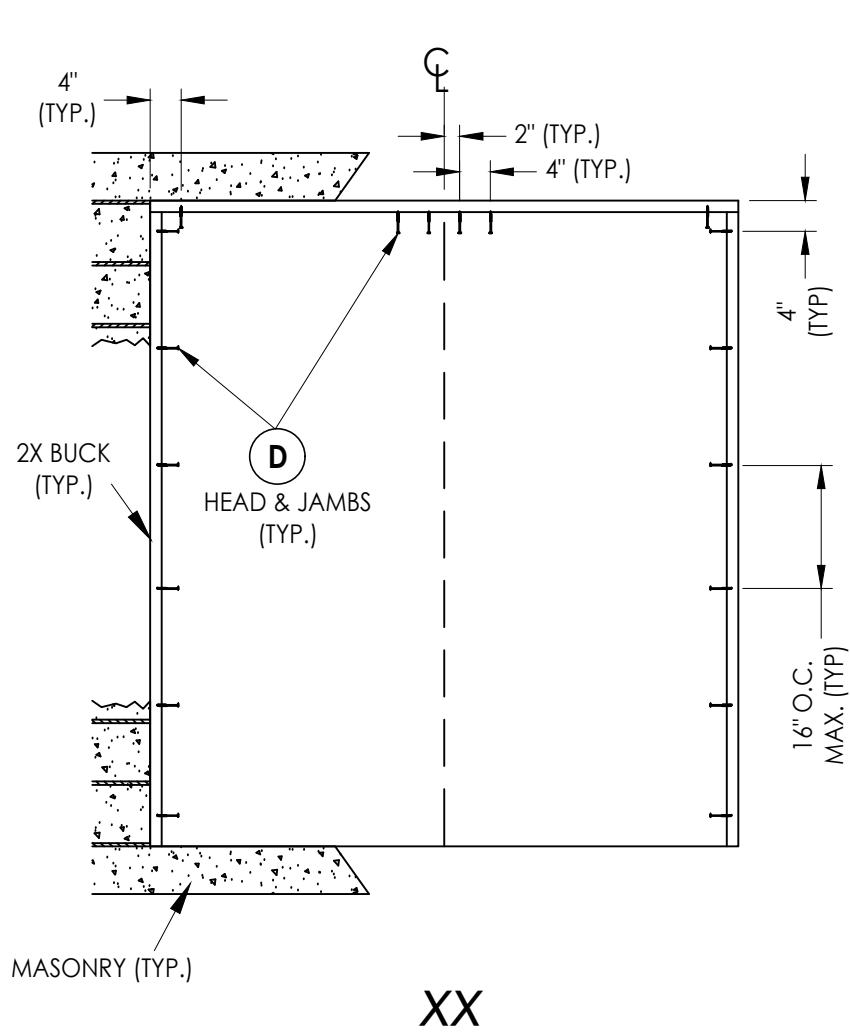







2X BUCK ANCHORING

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: TRINITY FIBERGLASS PATIO DOOR "Impact"				PART OR ASSEMBLY: BUCK ANCHORING			
DATE: 6/22/23				REVISIONS			
SCALE: N.T.S.							
DWG. BY: RW							
CHK. BY: LFS							
DRAWING NO.: FL-37185.4							
SHEET 10 OF 12							

FRAME CORNERS ATTACHED w/
(3) #8 X 2" DRYWALL SCREWS @
HEAD & SILL (TYP.)

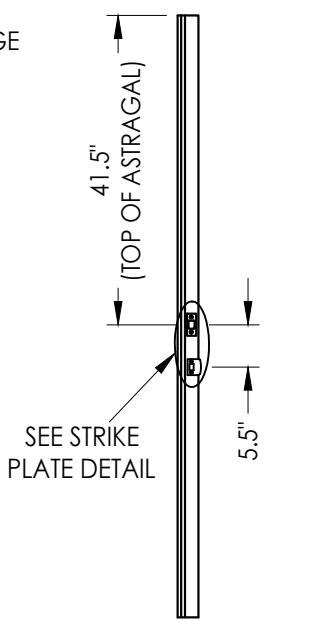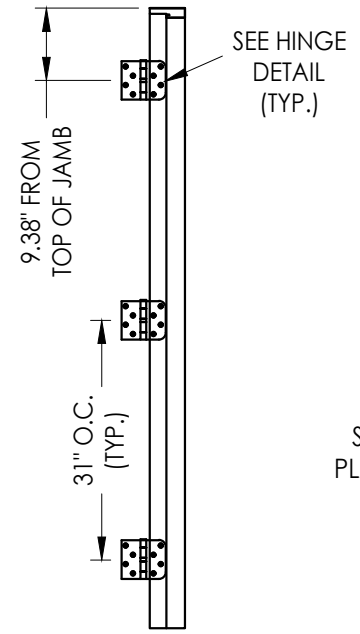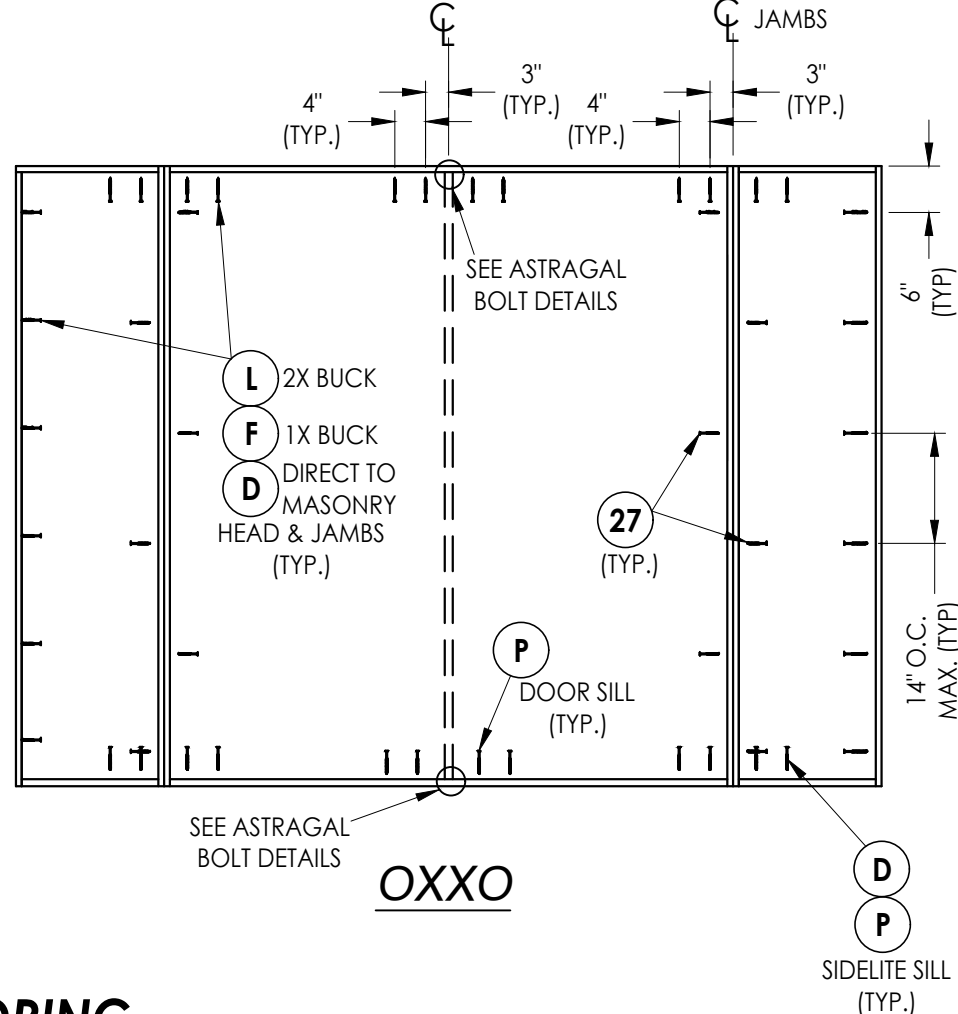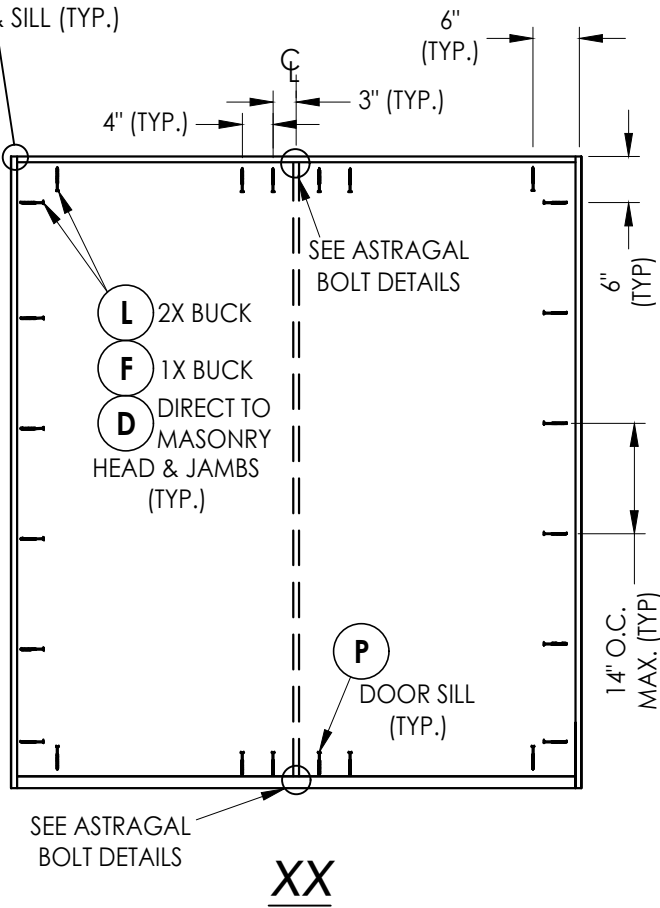

FRAME ANCHORING

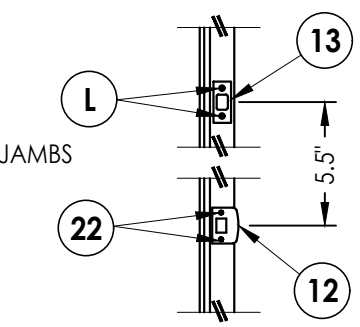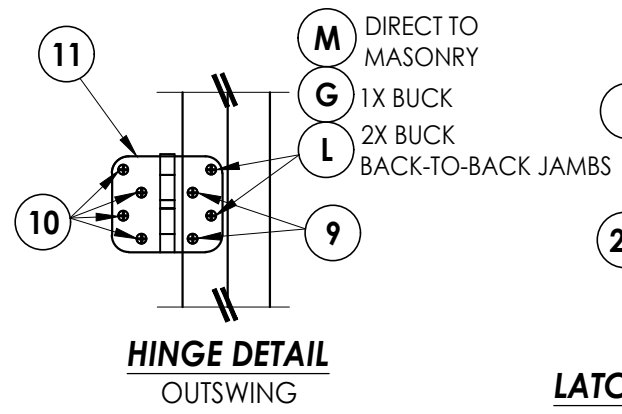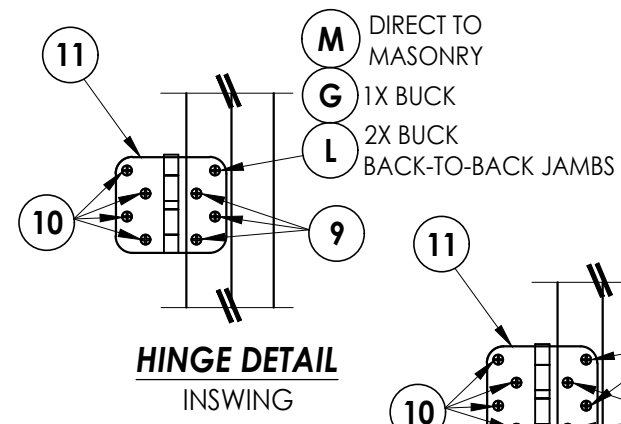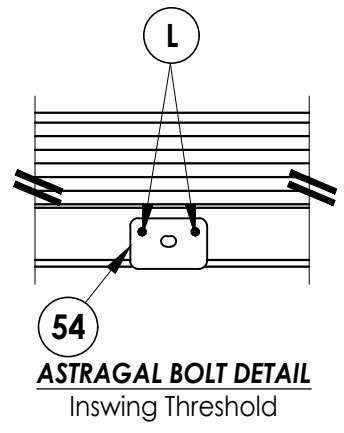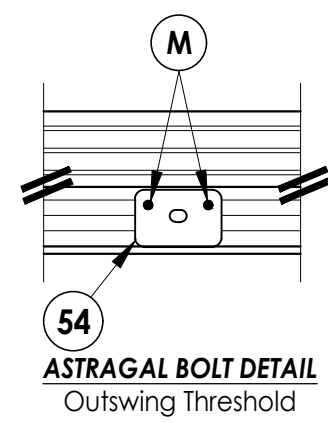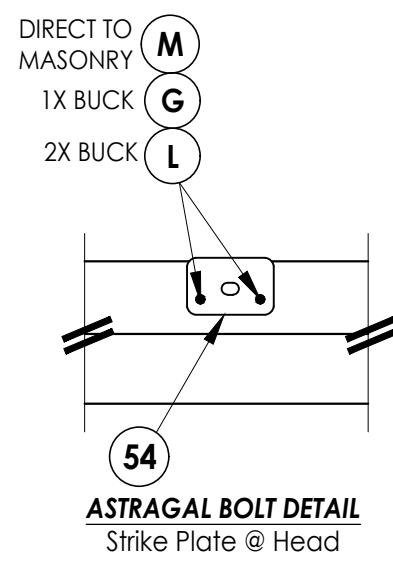

HARDWARE DETAILS

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				RW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT:		TRINITY		FIBERGLASS PATIO DOOR "Impact"			
PART OR ASSEMBLY:		FRAME ANCHORING & HARDWARE DETAILS					
						LFS	
						BY	
						REVISIONS	
DATE: 6/22/23							
SCALE: N.T.S.							
DWG. BY: RW							
CHK. BY: LFS							
DRAWING NO.: FL-37185.4							
SHEET 11 OF 12							

Z:\2023 FBC Drawings\Trinity Glass Int\FL-37185 R2\FB-37185.4.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (G >= 0.42)	WOOD
B	2X BUCK (G >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMB.)	STEEL
M	3/16" X 2-1/4" PFH ITW CONCRETE SCREW	STEEL
P	1/4" X 2-1/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
1	PVC JAMB	COMP
2	WOOD JAMB	WOOD
7	WEATHERSTRIP	FOAM
8	DOOR SWEEP	VINYL
9	#9 X 3/4" PFH WOOD SCREW	STEEL
10	#9 X 1" PFH WOOD SCREW	STEEL
11	4" X 4" HINGE	STEEL
12	LATCH STRIKE PLATE	STEEL
13	DEADBOLT STRIKE PLATE	STEEL
14	INSWING THRESHOLD	ALUM/COMP
15	OUTSWING THRESHOLD	ALUM/COMP
16	INSWING SIDELITE ADAPTER	PVC
17	OUTSWING SIDELITE ADAPTER	PVC
22	#8 X 2-1/2" PFH WOOD SCREW	STEEL
27	#10 X 2" PFH SMS	STEEL
40	DOOR PANEL	-
50	SIDELITE PANEL	-
53	ALUMINUM ASTRAGAL	ALUM
54	ASTRAGAL STRIKE PLATE	STEEL
55	#8 X 1" PFH WS	STEEL


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW BUILDEX TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:


- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

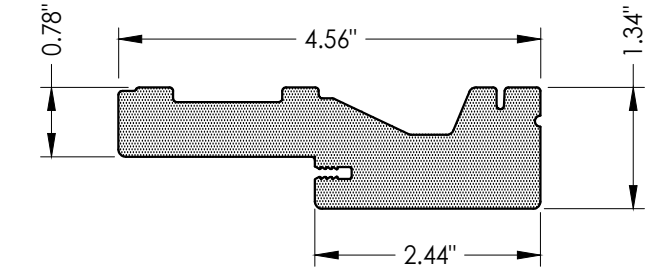


1 PVC JAMB

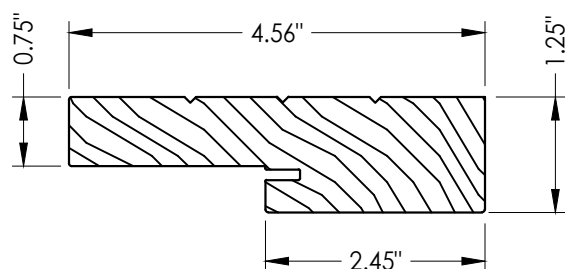


2 WOOD JAMB
FINGER JOINTED PINE

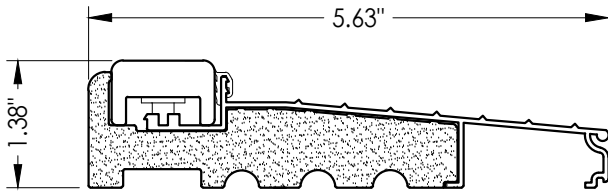


14 INSWING THRESHOLD

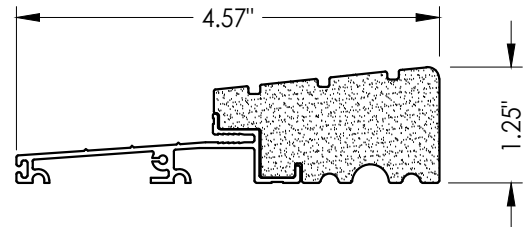


15 OUTSWING THRESHOLD



16 INSWING SIDELITE ADAPTER



17 OUTSWING SIDELITE ADAPTER

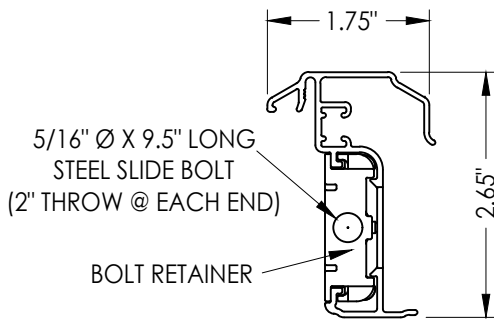

53 ENDURA ASTRAGAL
Ultimate Hurricane

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: TRINITY
FIBERGLASS PATIO DOOR
"Impact"

PART OR ASSEMBLY:
BILL OF MATERIALS
& COMPONENTS

NO.	DATE	REVISIONS
1	7/31/23	UPDATE TO 8TH ED. (2023) FBC
LFS	BY	

DATE: 6/22/23

SCALE: N.T.S.

DWG. BY: RW

CHK. BY: LFS

DRAWING NO.:

FL-37185.4

SHEET 12 OF 12